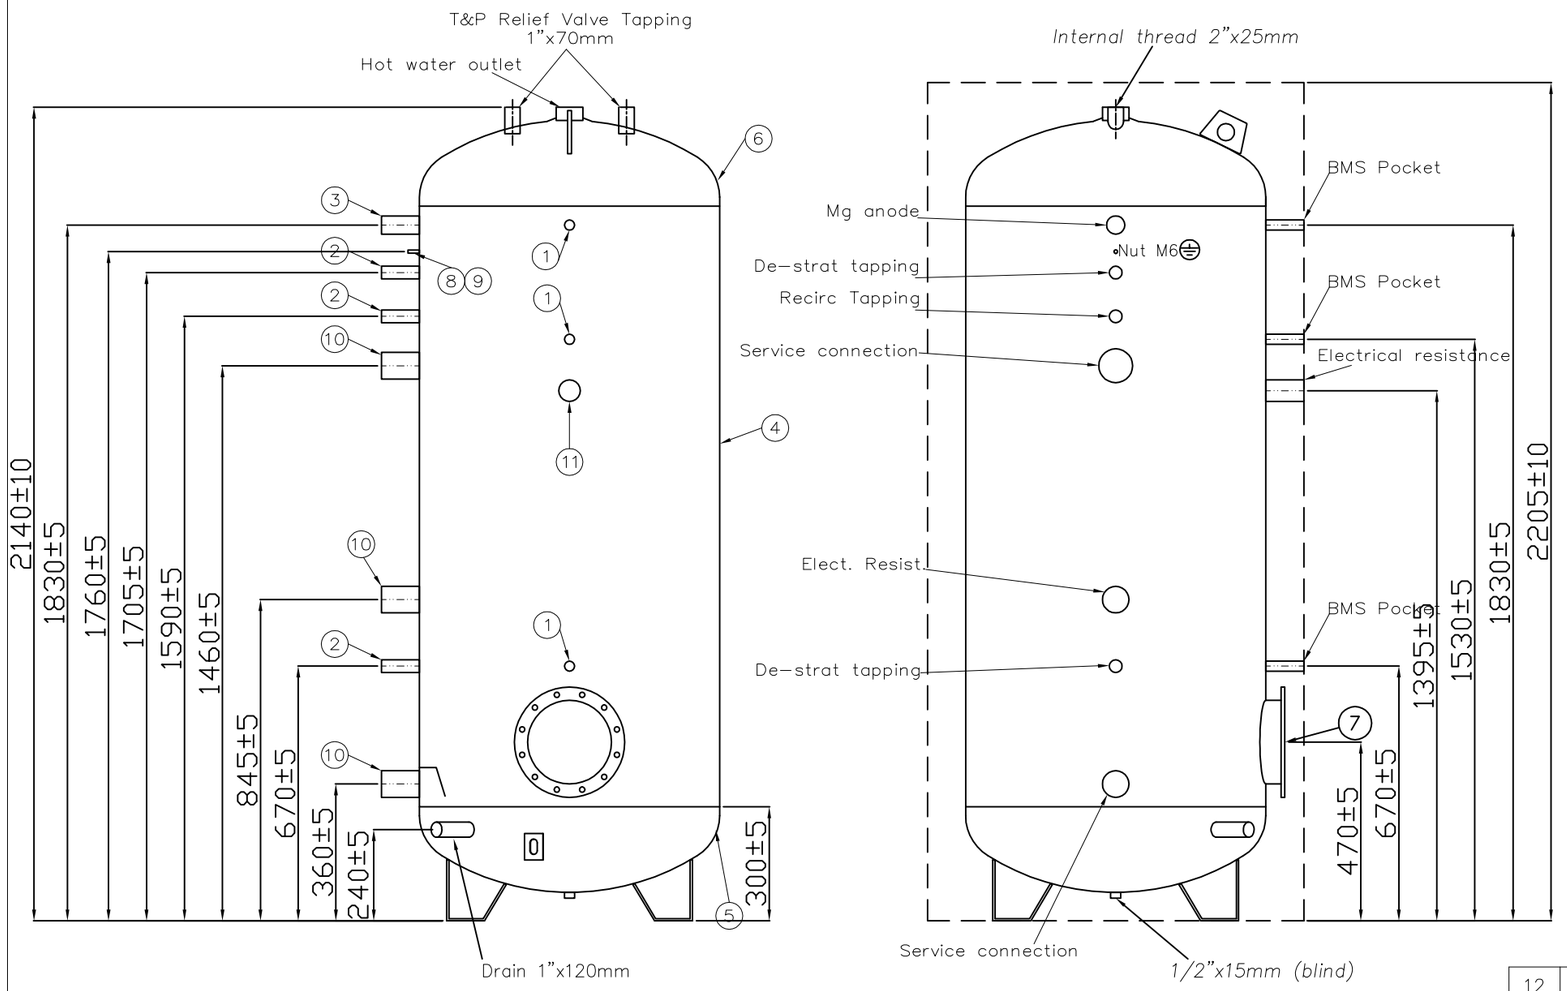

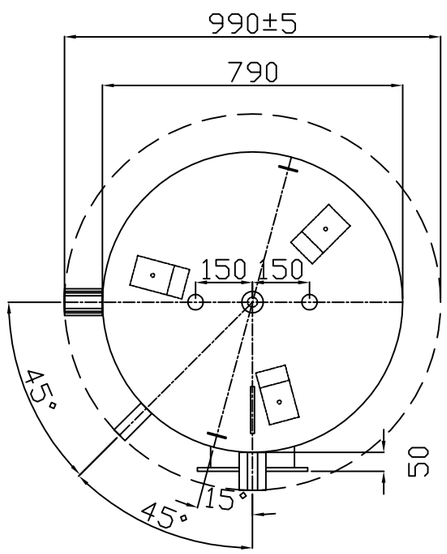

Final draft, agreed and signed 12.1.21

Andy Clifford

- SERBATOIO REALIZZATO SU SPECIFICHE DEL CLIENTE
- STORAGE TANK REALIZED ON CUSTOMER SPECIFICATIONS
- BALLON REALISE' SUR SPE'CIFIQUE DU CLIENT

01

POS.	DESCRIPTION:	MATERIAL:	Q.TY:	CODE:
12				
11	Internal thread 1"1/2x105 mm	S235JR	1	91710630
10	Internal thread 2"x105 mm	S235JR	2	91710710
9	Screw TE M6x10 mm	GALVANIZED	1	98120010
8	Nut M6x30mm	S235JR	1	98610001
7	Flange Ø290	S235JR	1	91C10016
6	Upper Semifinished	DD12/S235JR	1	F08204S3861
5	Lower Semifinished	DD12/S235JR	1	I08A040030
4	Metal sheet 2472x1580x30/10	DD12	1	912S3862 91120265
3	Internal thread 1"1/4x105 mm	S235JR	1	91710500
2	Internal thread 3/4"x105 mm	S235JR	3	91710240
1	Internal thread 1/2"x105 mm	S235JR	3	91710130

REVISIONS:

06		
05		
04		
03		
02		
01	17-12-2020	Added 2" on the side on request of client (F. Perina)
00	25-09-17	Created drawing

TESTING PRESSURE IS ONE AND A HALF OF WORKING PRESSURE

EFFECTIVE CAPACITY(LT.):	PRIMARY CAPACITY (LT.):	PRIMARY WORKING PRESSURE (BAR):	SECONDARY CAPACITY (LT.):	SECONDARY WORKING PRESSURE (BAR):	WEIGHT (KG):
955	...	10	...	...	...

ALL RIGHTS RESERVED. THIS DRAWING IS NOT TO BE GIVEN TO THIRD PARTS WITHOUT OUR WRITTEN AUTHORIZATION

MATERIAL: S235JR / DD12

TREATMENT: SMALGLASS

FIRST ANGLE PROJECTION:

DIMENSIONS IN MILLIMETERS

TOLERANCES NOT SHWON: EN 22768-1 - V

DESIGNER: D.MATTIOLI

CHECKED: G. ZENARI

CHECKED: ...

DESCRIPTION:

PROSTOR BV 1000

Commercial Hot Water Solutions Ltd.

DATE CREATED: 25-09-17

CODE: B09A04S3862